SPON

CLOUD AUDIO ADAPTER
Installation Manual

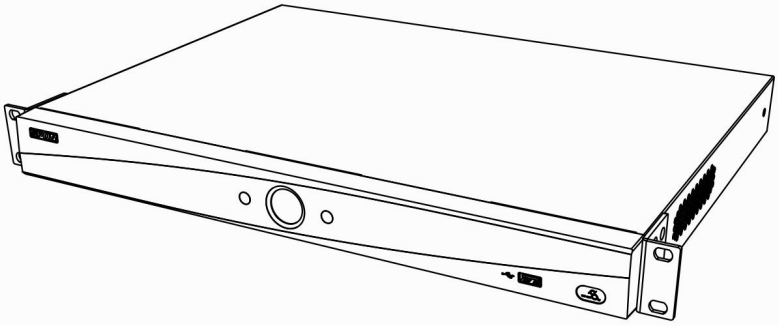

IP NETWORK PUBLIC ADDRESS SYSTEM

Interface Description

Front Panel

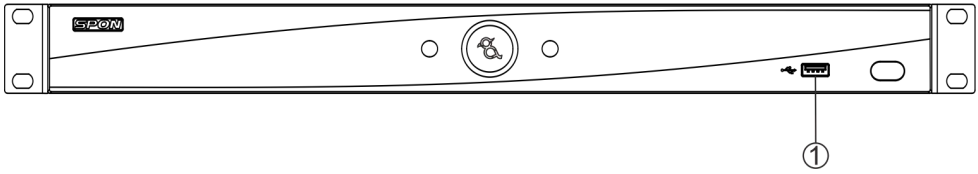

① USB interface: After plugging in the USB flash drive, touch the page button (page up button, page down button) at the same time to upgrade the device locally.

Back Panel

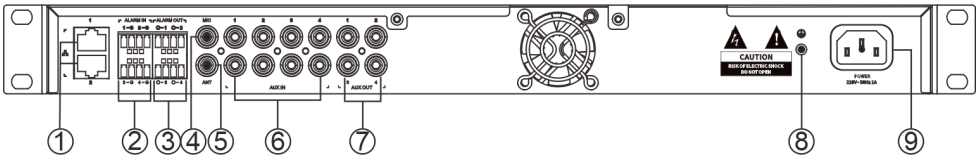

① Port 1 is network interface; Port 2 is device cascade port that connects to the next terminal or other network devices

② Alarm in interface(4 channels)

③ Alarm out interface(4 channels)

④ Non-moving-coil microphone input interface (the default is force insert, it can be customized)

⑤ FM antenna interface

⑥ Line in interface(4 channels)

⑦ Line out interface(4 channels)

⑧ Safety grounding terminal

⑨ Power input interface: AC220V power input

Wiring

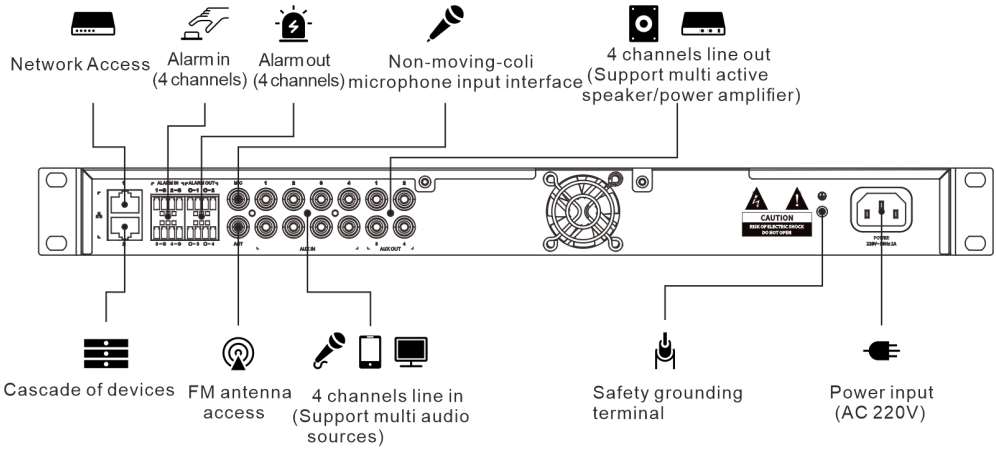

Installation Diagram

Installation method 1: Rack installation

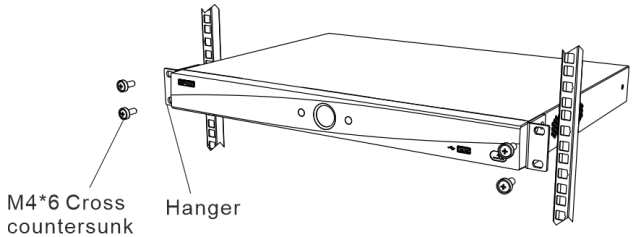

Note: Frame fixing screw need to be prepared by yourself

Installation method 2: Desktop installation

Used accessories package materials:
Φ12*3 (foot mat)X4

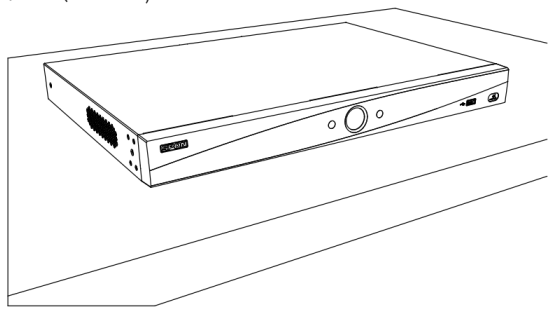

Specifications, Functional Unit and Parameters

Power	220V~50Hz
Protection	Overcurrent, short circuit, overheat protection, AC fuse
Rated Current	1A
Surge Protection	Power supply: common mode 4KV, differential mode 2KV; Power output: common mode 2KV
Audio sampling, bit rate	48kHz，24bit
Heat Dissipation	Intelligent temperature control fan forcibly dissipates heat
Frequency Response	40Hz-18kHz
THD (total harmonic distortion)	≤0.5%（1kHz，1/2 power output）
SNR(Signal to Noise Ratio)	MIC：≥85dB; AUX：≥95dB
Input sensitivity & Input impedance	MIC：-20dBV/10KΩ；AUX：0dBV/10KΩ
Operating temperature, Operating humidity	0C~+50C，≤90%RH（nodew）
Dimension	483*334*44mm（L*W*H）

Packing List



Adapter 1pcs
(6.35 stereo male head/
3.5 stereo female head black)

Hanger 2pcs

Countersunk cross screw 8pcs(M4*6)

Foot mat 4pcs
(Φ12*3 3M)



3.5-RCA lotus plug cord
1pcs(1.5meters)

Connection terminal
4pcs(3.81-4P)

Installation manual 1pcs

Certification 1pcs

SPON Communications Co., Ltd.
www.sponcomm.com
Service Hotline: +86-731-85570190
Reserve the amendment right without notice

V1. 0B230919